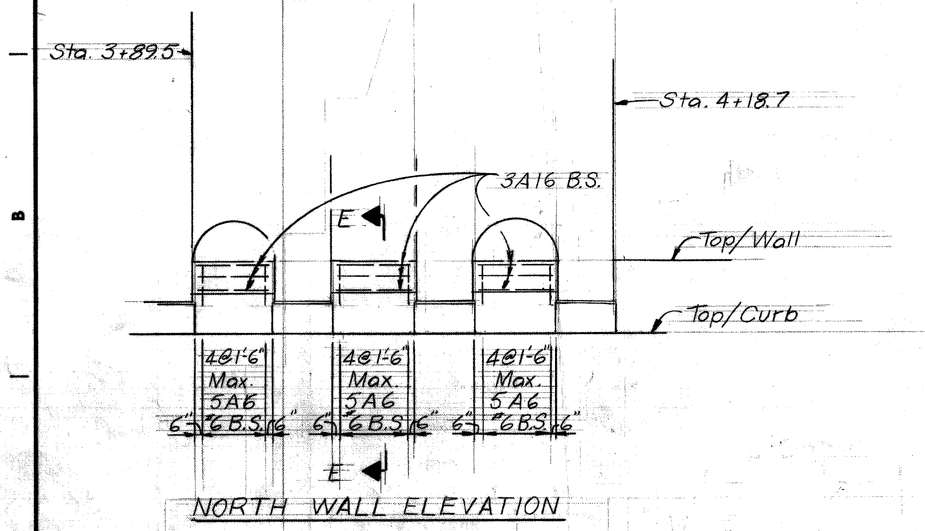

NORTH WALL ELEVATION

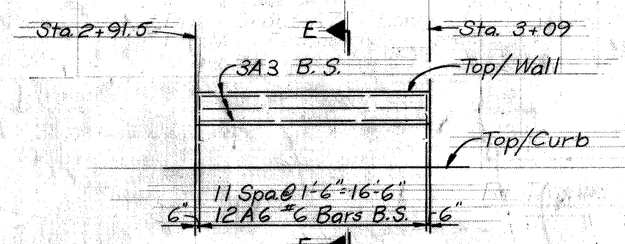

NORTH WALL ELEVATION

SOUTH WALL ELEVATION

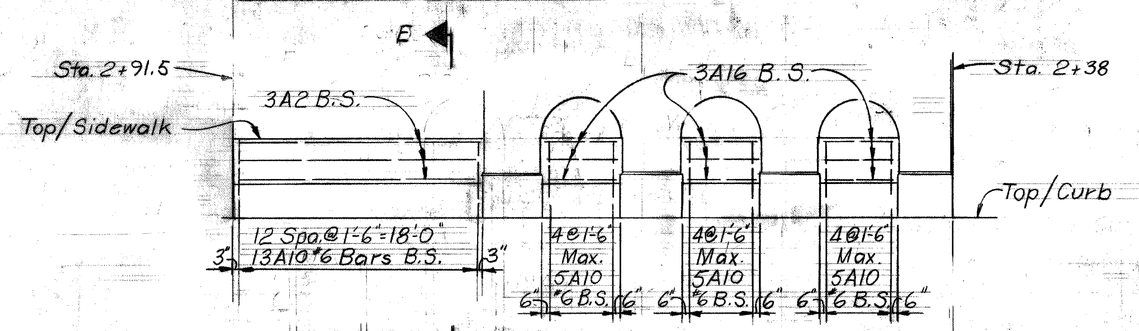

SOUTH WALL ELEVATION

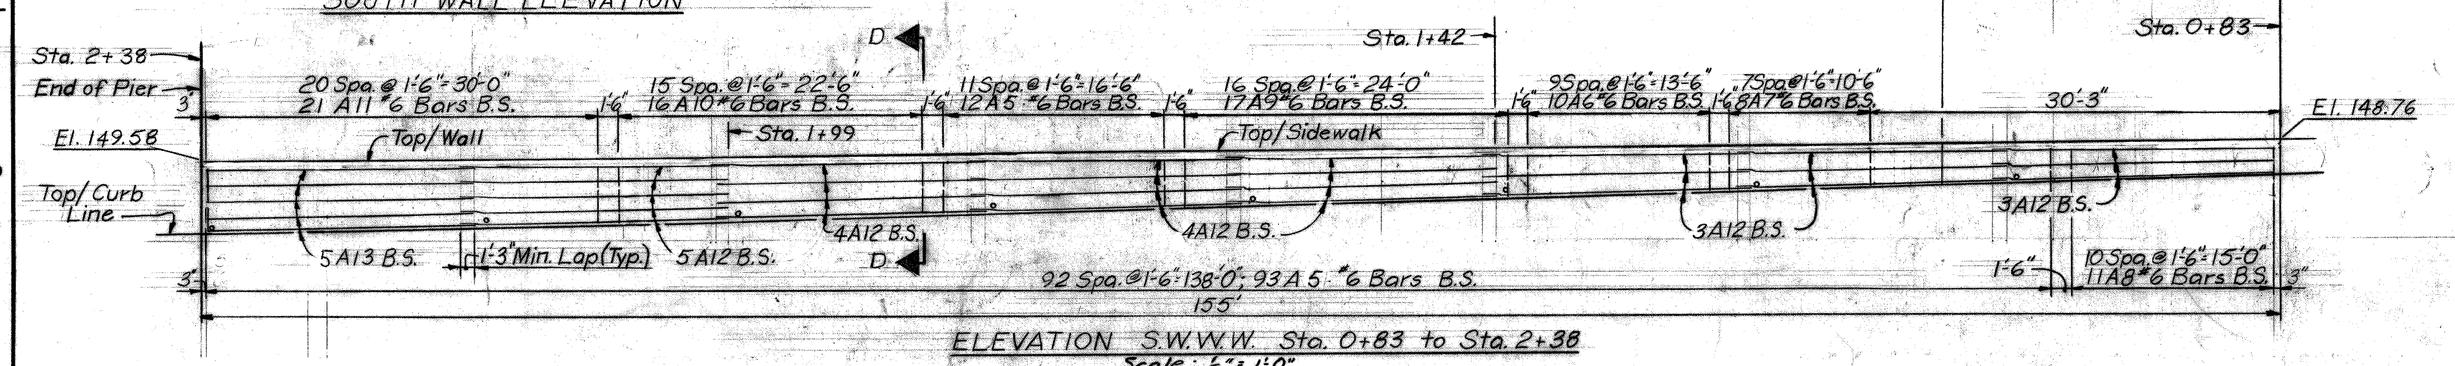

ELEVATION S.W.W.W. Sta. 0+83 to Sta. 2+38
Scale: ½" = 1'-0"

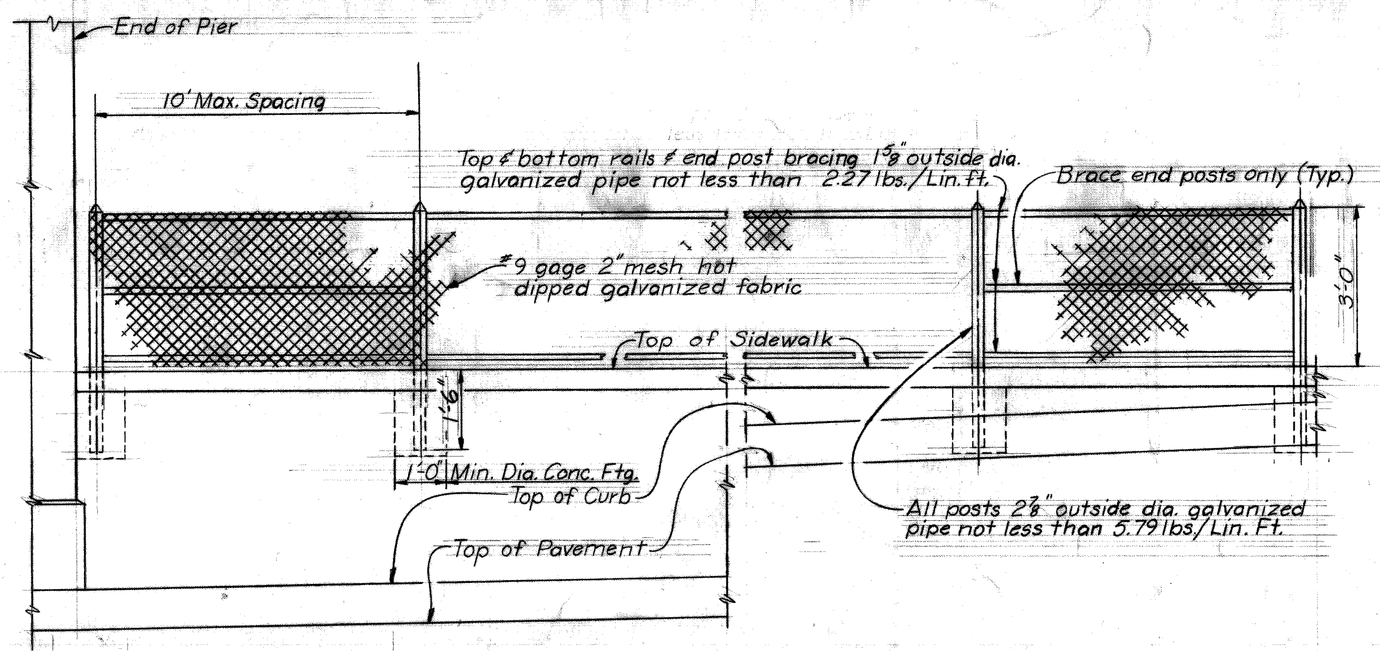

NOTES:

Fittings & fastenings shall be malleable, wrought iron or pressed steel and galvanized. Wire used in fastening the fabric shall be not less than #9 gage. The bands of wire shall be not less than 12" apart on the posts and not more than 15" apart on the top rail.

All fencing materials shall be coated with a plasticized polyvinyl chloride, except that portion of the posts to be imbedded in concrete.

The fencing material shall be either:
(a) Anchor Vinyl Coated Steel Chain Link Fence with a color coating black , supplied by the Anchor Fence Division, Anchor Post Products, Inc.
(b) Color Bond with a color coating black , supplied by the Color Guard Corp. Raritan, N.J.
(c) or approved equal to the above.

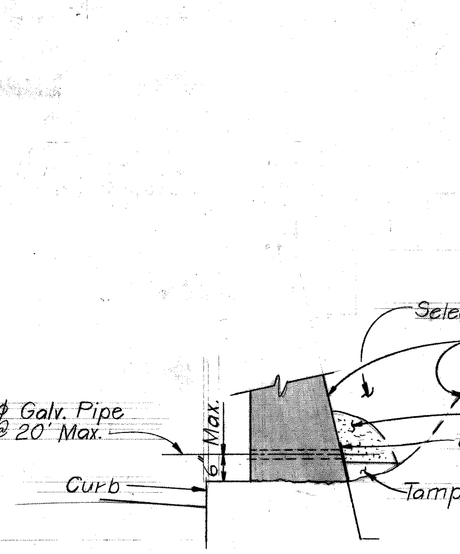

SECTION @ WALL DRAIN

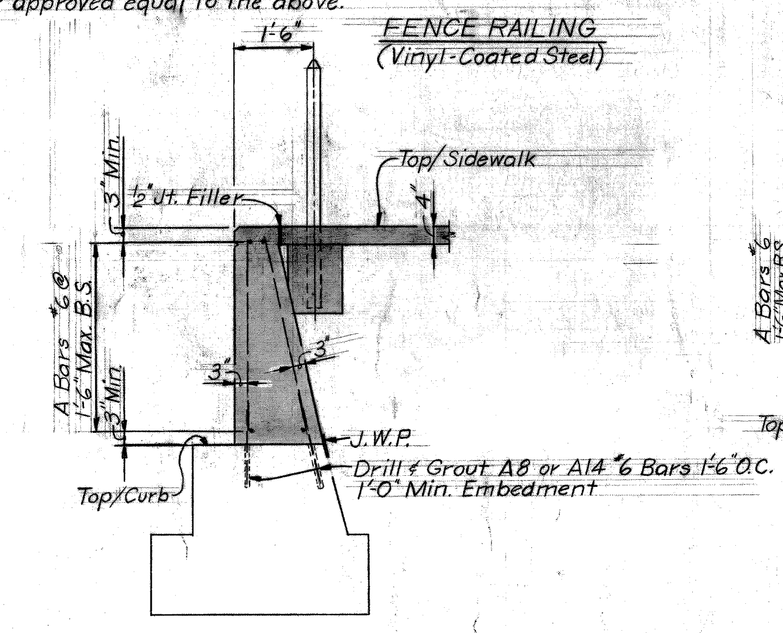

SECTION D-D

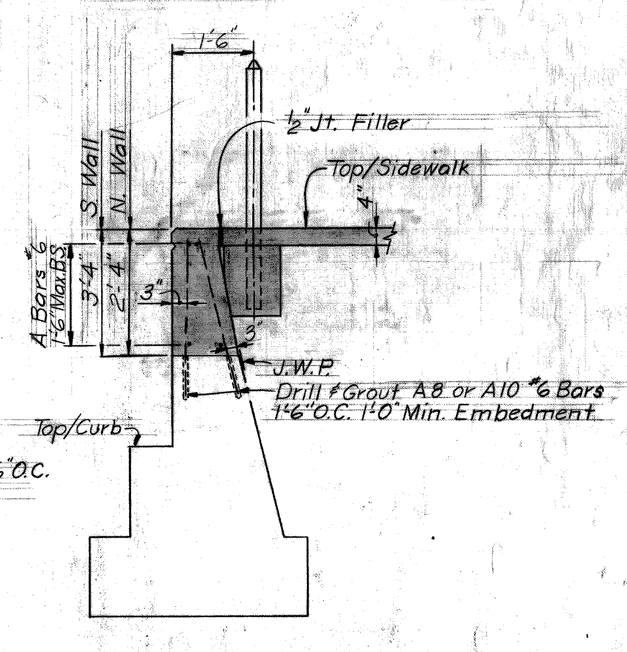

SECTION E-E

STEEL REINFORCEMENT DETAILS

No.	length	size	quan.	weight
A1	3'-9"	#6	106	597
2	18'-0"	#6	6	162
3	17'-0"	#6	16	409
4	19'-9"	#6	16	475
5	4'-0"	#6	564	3389
6	2'-9"	#6	74	306
7	2'-3"	#6	36	122
8	3'-6"	#6	314	1651
9	3'-3"	#6	34	153
10	4'-3"	#6	88	562
11	4'-9"	#6	92	656
12	20'-0"	#6	190	5707
13	21'-0"	#6	10	315
14	6'-6"	#6	4	39
15	11'-9"	#6	4	71
16	5'-3"	#6	36	284
Total				14489

COOR'D	DESCRIPTION	DR'N	CK'D	AP'VD	DATE

REVISIONS LOCATED BY COORDINATES ON SHEET

REFERENCE DRAWINGS

DESIGNED BY WAL
DRAWN BY L.G.
TRACED BY
CHECKED BY RRB

APPROVED:
CITY ENGINEER

CITY OF DETROIT
DEPARTMENT OF PUBLIC WORKS
CITY ENGINEERS' OFFICE
FOR
WALL, SIDEWALK & RAILING REPAIR

HOLDEN AVE. UNDER BRIDGE XU-6
PENN CENTRAL & GRAND TRUNK WESTERN R.R.
DETAILS

SHEET 4 OF 4 SHEETS
CONTRACT No.
DRWG No.
DATE 11-72

XU6-12(a)