

no.	date	by	description

designed by H. DICKOW
 drawn by H. DICKOW
 checked by H. DICKOW
 approved: _____

STRUCTURAL ENGINEER

CITY OF DETROIT
 city engineering department
 for MICHIGAN DEPARTMENT OF TRANSPORTATION

BRIDGE PROTECTIVE SCREENING DETAILS

LAFAYETTE ST. CROSSING JOHN C LODGE EXPRESSWAY (US-10) IN DETROIT S12 OF 82111

contract no. a.o-87-22-21
 sheet 2 of 3
 date 10-1-87

FENCING NOTES

ALL WORK SHALL CONFORM TO THE M.D.O.T SPECIFICATIONS FOR HIGHWAY CONSTRUCTION. 1984 EDITION EXCEPT AS SHOWN OR NOTED ON THE PLAN.

THE POST SHALL BE ROUND POST HAVING AN OUTSIDE DIAMETER OF 2.375" AND WEIGHT OF 5.79 LBS. PER FT. GALVANIZED. NOMINAL 1/4" PIPE SHALL BE 1.98" OUTSIDE DIAMETER STEEL PIPE OR TUBING WEIGHING 2.27 LBS. PER FT. GALVANIZED.

ALL POSTS AND TUBING SHALL BE FURNISHED WITH MANUFACTURERS STANDARD CONNECTIONS AND ITS MINIMUM WEIGHT SHALL BE WITHIN 5% OF THAT SPECIFIED. POSTS SHALL BE BENT IN THE SHOP AS SHOWN ON THE PLANS.

ALL COMPONENTS ARE TO BE GALVANIZED IN ACCORDANCE WITH A.S.T.M. A-153 AFTER FABRICATION.

FABRIC FASTENERS SHALL BE DOUBLE TWISTED, 9 GAUGE GALVANIZED STEEL.

ALL FABRIC OR CHAIN LINK FENCE SHALL BE FURNISHED WITH KNUCKLING AT BOTH SELVAGES.

TENSION BARS SHALL BE 3/4" X 1/4" GALVANIZED STEEL.

FENCE FABRIC SHALL BE GALVANIZED, #9 GAGE WITH A 1" MESH.

THE BID ITEM "PEDESTRIAN FENCING-STRUCTURES" SHALL INCLUDE THE FABRIC, POSTS, BRACES, ANCHORED BOLTS, PIPE, BRACKETS, BASE PLATES AND ALL SUITABLE CONNECTIONS AND FITTINGS.

THE CONTRACTOR WILL BE FURNISHED WITH PLANS OF THE EXISTING STRUCTURE IF REQUESTED. HE SHALL ALSO VERIFY FIELD CONDITIONS BEFORE FABRICATION.

THE PAY LIMITS FOR "PEDESTRIAN FENCING-STRUCTURES" IS MEASURED FROM THE TOP OF OF SIDEWALK TO TOP RAIL OF FENCE.


CARE SHALL BE TAKEN SO THAT DEBRIS DOES NOT FALL FROM STRUCTURE.

WHERE SIGNS MOUNTED ON BRIDGE FASCIA'S INTERFERE WITH CONSTRUCTION, THEY SHALL BE REMOVED AND RESET AT THE CONTRACTORS EXPENSE.

CARE IS TO BE TAKEN IN PLACING ANCHORED BOLTS AND BRACKETS SO AS TO INSURE THAT THE BRACKETS HOLD THE POSTS FIRMLY AGAINST STEEL POST, SHIM IF NECESSARY.

2" X 2 1/4" H POST WEIGHING 4.1 LBS PER FT. GALVANIZED MAY BE USED AS AN OPTION FOR THE ROUND POST.

GROUNDING NOTES AND DETAIL

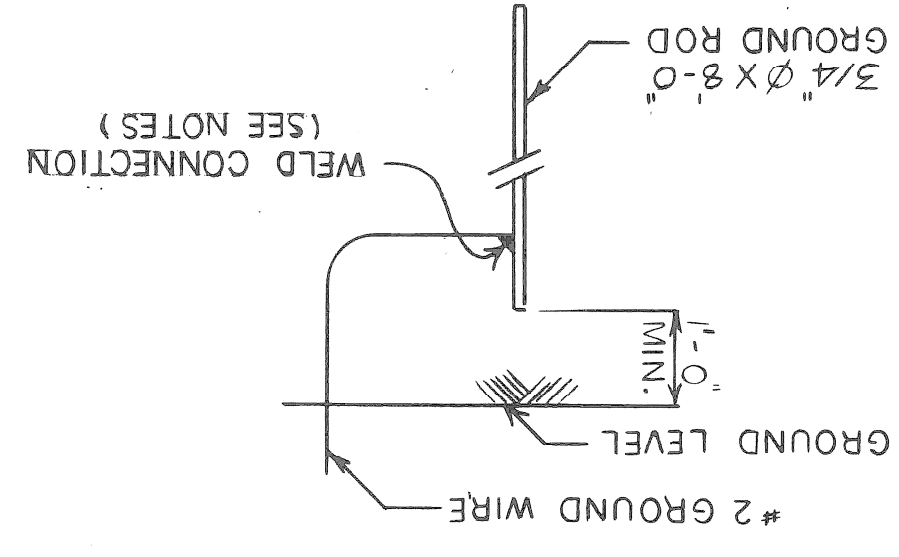

MAINTAIN ONE FOOT MINIMUM COVER OVER GROUND WIRE AND GROUND ROD.

ALL UNDERGROUND CONNECTIONS SHALL BE MADE BY CADWELD, THERMITE, GAS OR ARC WELD.

EXPOSED CONNECTIONS MAY BE SPLIT BOLT OR CLAMP TYPE.

GROUND WIRE SHALL BE BARE #2 AWG AND SHALL CONFORM TO THE LATEST REVISION OF THE APPLICABLE CURRENT ASTM SPECIFICATION ASTM B 33 FOR TINNED SOFT OR ANNEALED COPPER WIRE FOR ELECTRICAL PURPOSES.

GROUND ROD SHALL BE STEEL, COPPER CLAD ROD 3/4 MIN. DIA. AND 8'-0" LONG.

MISCELLANEOUS QUANTITIES

ITEM	UNIT	AMOUNT
PEDESTRIAN FENCING - STRUCTURES	S.F.T	2297
ELECTRICAL GROUNDING SYSTEM	EACH	1

