

DTE Energy - Gas Co.
Data Integrity and Technology
One Energy Plaza, WCB-1836
City of Detroit, MI 48226

June 9, 2014

Richard Doherty, CED DPW Head Engineer
City Engineering Division, DPW
65 Cadillac Square, Suite 900
Detroit, Michigan 48226-2873

RE: Petition #124: Request to Vacation the East/West and the North/South Public Alley, 16 Ft. Wd. in the Block Bounded by Sorrento, Wadsworth, Steel Ave and Plymouth Rd.

- Not involved. **See Remarks**
- Involved: but asking you to hold action on this petition until further notice.
- Involved but have no objection to the property change - - provided that an easement of the full width of the public right-of-way (street, alley or other public place) is reserved.
- Involved: the nature of our services, and the estimated costs of removing, rerouting or abandonment of such all gas mains and/or services

REMARKS:

DTE Energy Gas Company has no involvement, nor objection to Petition #124as mentioned above. See enclosed strip print and attached notice of public hearing, for your use and information.



Please abide by Public Act 174, three (3) working days before you dig, dial toll free MISS DIG at: 1 – 800 – 482 – 7171.

DTE Energy Gas Leak Emergency Phone Number: 1- 800 – 947 – 5000.

Sincerely,

***RS* Russell E Thornton**
Drafter
Data Integrity and Technology

RET/
Enclosure

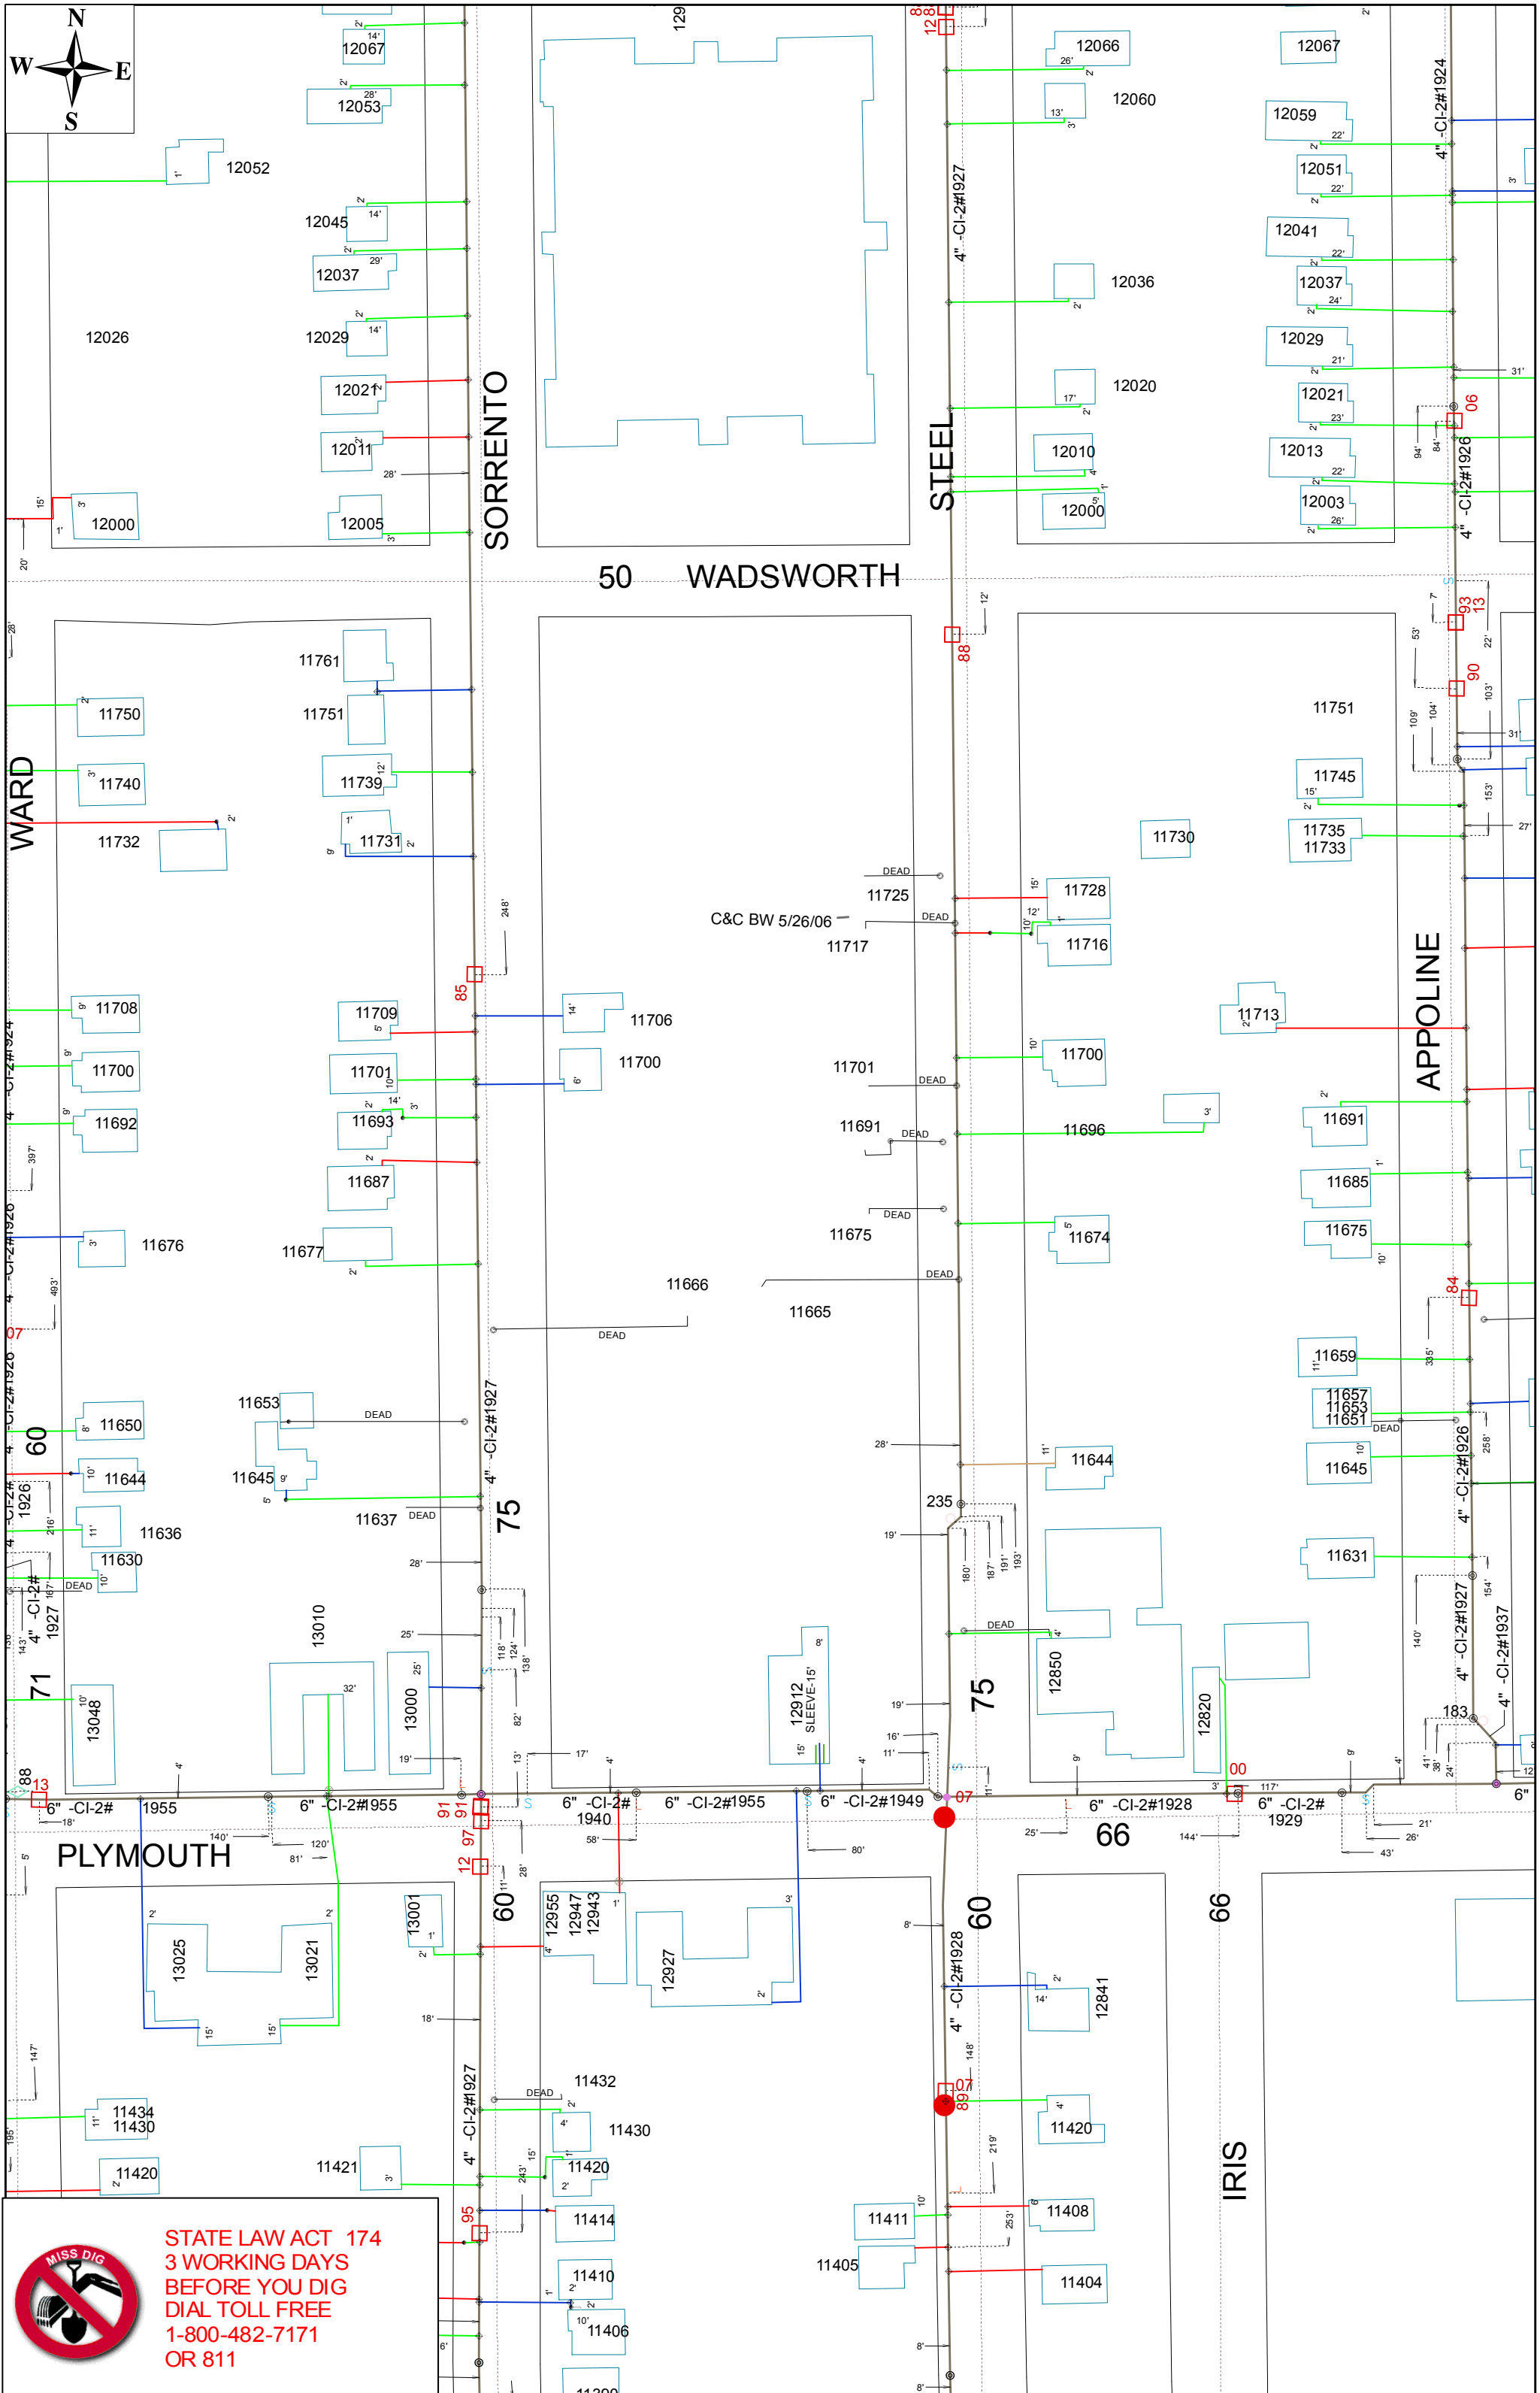

STATE LAW ACT 174
3 WORKING DAYS
BEFORE YOU DIG
DIAL TOLL FREE
1-800-482-7171
OR 811