




VACATE ENTIRE ALLEY NORTH OF ALFRED  
BETWEEN JOHN R AND BRUSH  
TOTAL COST: \$148,927.69

VACATE ALLEY FROM  
NET BANK TRANSFORMER #463 TO BRUSH ST.  
TOTAL COST: \$113,973.86

DTE ENERGY WILL NEED TO MAINTAIN AN EASEMENT  
THAT IS THE FULL WIDTH OF THE ALLEY FROM  
THE EAST SIDE OF (R.O.W.) LINE OF JOHN R AND  
EXTENDING 100' FT. EAST TO NB TRANSFORMER #463.

\*NB463 TRANSFORMER IS FEEDING ACROSS JOHN R

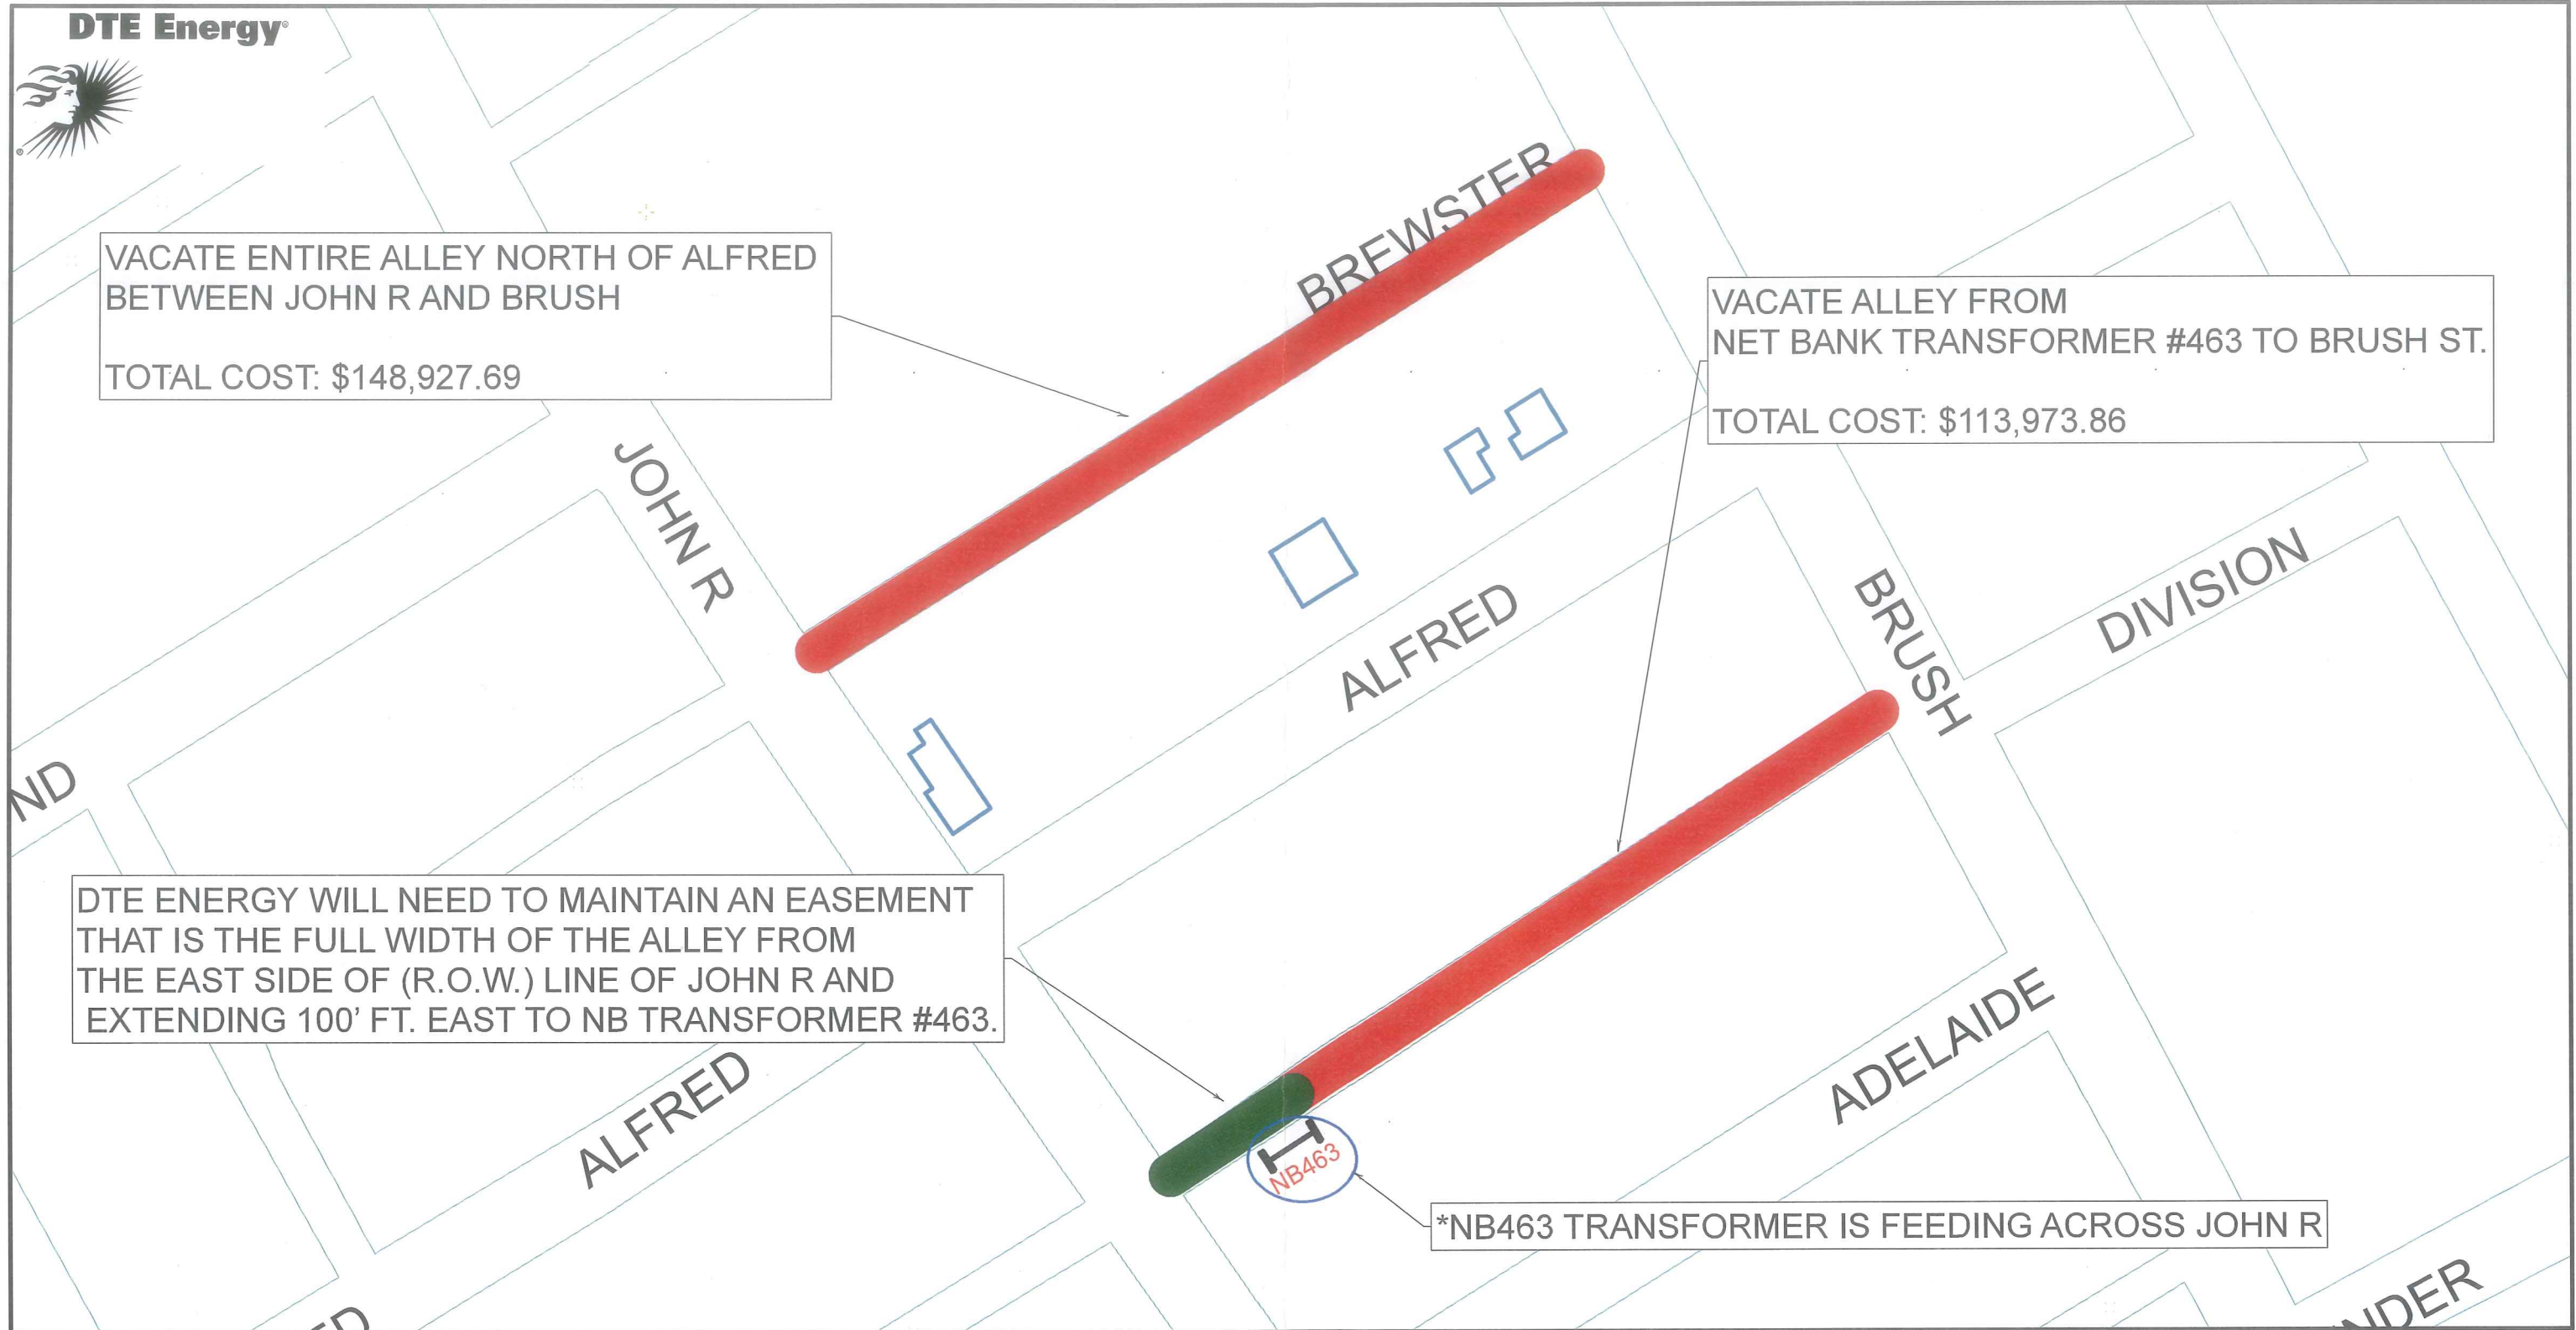

		DTE ELECTRIC COMPANY SEREGIONAL PLANNING	
		LAYOUT BY A. YAFFAI	DRAWN BY A. YAFFAI
		DATE 3/14/2016	DRAWING NUMBER
		SCALE NONE	<b>ATTACHMENT "A"</b>