

DTE Energy - Gas Co.
Data Integrity and Technology
One Energy Plaza, 838-GO
City of Detroit, MI 48226

May 18, 2017

Richard Doherty, CED DPW Head Engineer
City Engineering Division, DPW
2 Woodward Ave, Suite 642
Detroit, Michigan 48226-3462

RE: Petition #1534

Dated: 5/9/2017

- Not involved. **See Remarks**
- Involved: but asking you to hold action on this petition until further notice.
- Involved but have no objection to the property change - - provided that an easement of the full width of the public right-of-way (street, alley or other public place) is reserved.
- Involved: the nature of our services, and the estimated costs of removing, rerouting or abandonment of such all gas mains and/or services

REMARKS:

Involved but have no objections to the property change, provided that the request to outright Vacate the North/South public alley, 20 Ft. Wd in the block bounded by John R., Farmer St, Grand River and Woodward Ave. Reason being is that, DTE Energy Gas Co. has an existing Gas Service line (1-1/4"-PLA-1985) located at 102' EE Woodward at 1456 Woodward Ave. Otherwise, contact DTE Energy Gas Company Public Improvement Department: Kayla Shelton at 313-389-7211 (Supervisor) or Laura Forrester at 313-389-7261 (Gas Planner), for the estimated cost of our services in abandoning/removing/ and/or relocating/rerouting, including the survey, design and drawing of our utilities. See enclosed strip prints for your use and information regarding our gas main locations.

Please abide by Public Act 174, three (3) working days before you dig, dial toll free MISS DIG at: 1 – 800 – 482 – 7171.



DTE Energy Gas Leak Emergency Phone Number: 1- 800 – 947 – 5000.

Sincerely,

***RS* Russell E Thornton**

Drafter
Data Integrity and Technology



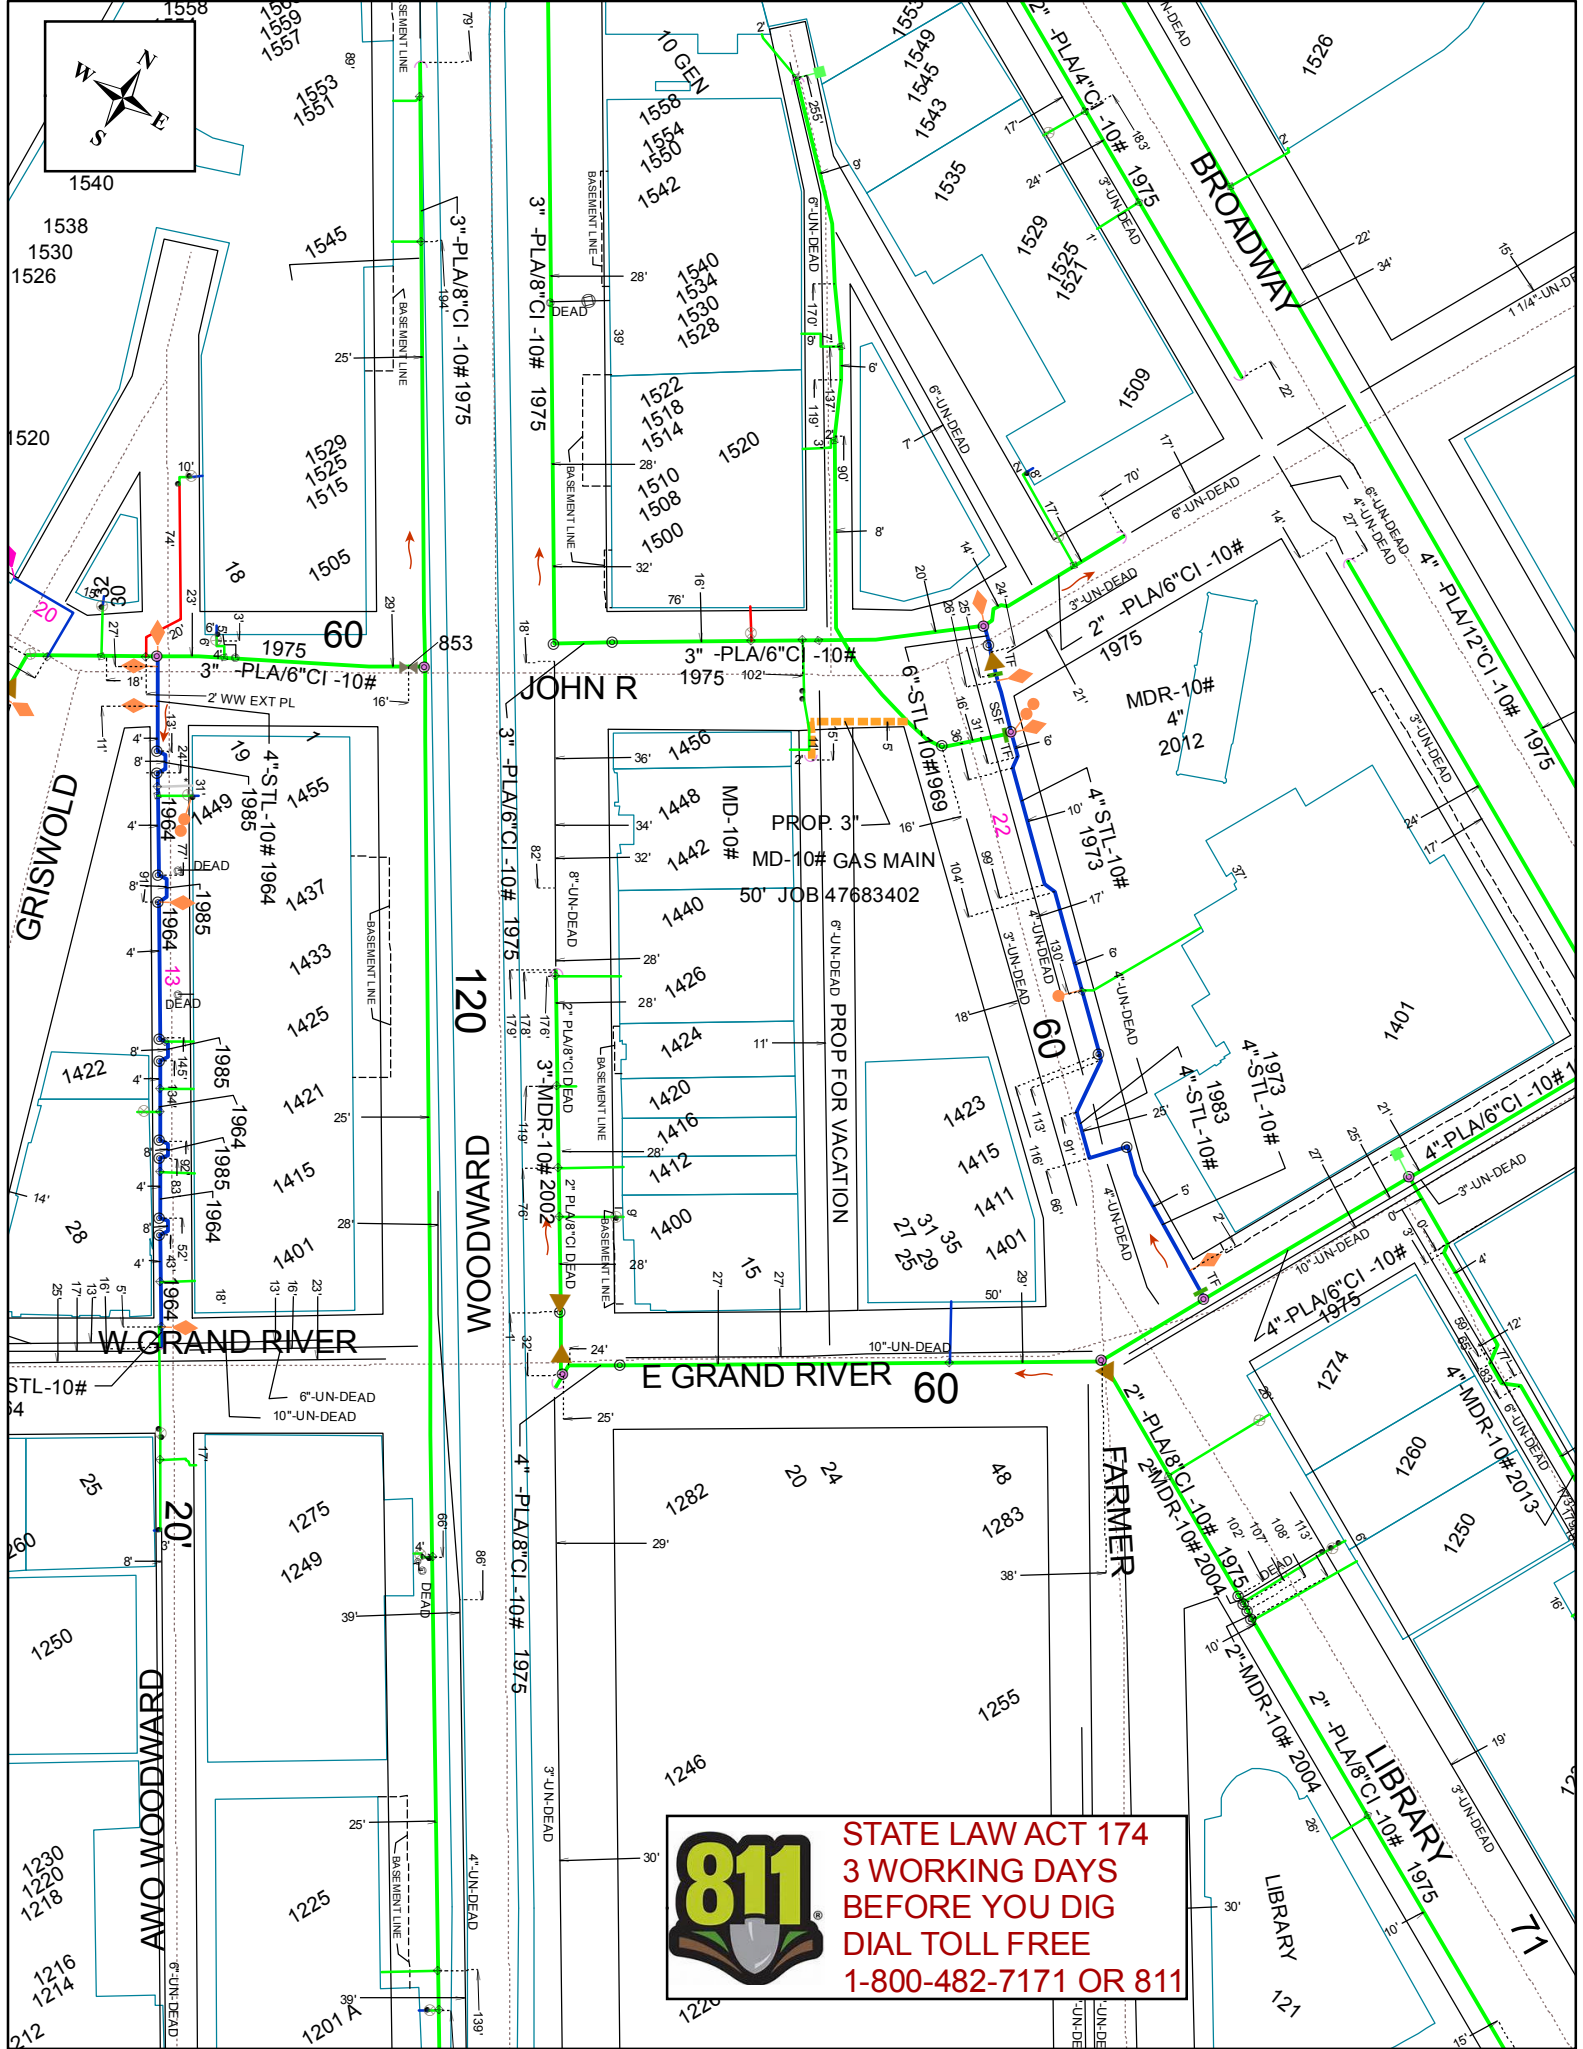


RET/
Enclosure



STATE LAW ACT 174
3 WORKING DAYS
BEFORE YOU DIG
DIAL TOLL FREE
1-800-482-7171 OR 811



Gas GIS Legend

Service Symbols




-  EndCap
-  LoopedService
-  Section
- EFV  Relief Valve
-  AbandonedService
- Aban. Service pipe

NOTE: Service line style is the same as the main it is tied into

Customer Events

-  Service Event
-  CUTCAP (CCtype, location)





AbandonedGasPipeSymbol

-  Abandoned Gas Device
-  End Cap
-  Section Symbol


Gas Pipe Protection

- ==== Casing
- ==== Shield
- ==== Sleeve

Land

- ==== Bridge
- ==== DrainCreek
- Easement
- ==== LotLine
- ==== RailRoad
- ==== RightOfWay
- Tunnel
- ==== Water
- Street Centerline
-  Building
-  Landmark
-  BrownField
-  Known Sites of Environmental Contamination DEQ Dec2008

CPAnode

-  Single
-  Multiple

CP Rectifier

-  Rectifier





Test Point

-  DOT
-  Regular TW




Tracer Wire

-  Tracer Wire





Gas Valve

-  Main, Closed
-  Main, Open
-  Service, Closed
-  Service, Open










Regulator Station

-  District
-  Secondary
-  Service












Controllable Fitting

- PCF Pressure Control Fitting
- SSF Short Stop
-  Stopple Fitting
-  Distribution Tiein
-  Subtransmission Tiein
-  Transmission Tiein









NonControllableFitting

-  Branch
-  Cap
-  Coupling
- == Ell
-  Insulated
-  Reducer
-  Section
-  Tee
-  Transition
-  <all other values>










Material Type

-  CU - Copper
-  CI - Cast Iron
-  PLA - Plastic
-  STL - Bare Steel
-  STL - Coated Steel
-  PLA - Plastic, Joint Trench
-  OTR - Other
-  UN - Unknown
-  WI - Wrought Iron
-  <all other values>
-  Inactive - all material types




Main Lines Styles

-  In Design Main (Proposed)
-  Distribution Main
-  Distribution - Joint Trench
-  Subtransmission Main
-  Transmission
-  Exposed Pipe (Coated Steel)
-  Pipe Lining (CI or WI)
-  AbandonedGasPipe

Other Symbols

-  Drip
-  Flow Arrow
-  Foreign Utility Pipe
-  Public Improvement
-  Pressure Monitoring Device
-  Leak Report - Leak Repair
-  Automated Repairs
-  LowPoint
-  Summit

Scaled Areas

-    10, 30, 50 SCALE